


VAV UNIT

VARIABLE AIR VOLUME (VAV) PRESSURE INDEPENDENT CONTROL

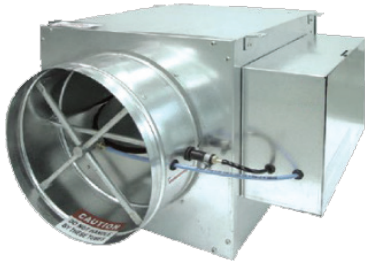

NAV UNIT SERIES

NenuTec Variable Air Volume (VAV) Terminal Units are volume flow rate controller for supply air on variable air volume system. These units are designed to control the airflow rate of conditioned air into an occupied space in response to a control signal from thermostat or Building Automation System (BAS). They could be used in stand alone system or interfaced with Modbus or BACnet.

FEATURES

- Oval shape damper for better flow management
- Neoprene peripheral gasket to prevent leakage
- Multi-point averaging inlet differential pressure sensor
- 1", 2 lbs fiberglass with black matt tissue internal insulation for noise reduction
- Round inlet with beading for good inlet connection
- Hexagon shaft for better grip mounting of actuator
- Shaft indicator indicating damper position
- Tube conceal (optional)
- Double layer heavy gauge damper blade
- Protective metal shroud for control components mounting
- Low pressure drop construction with round inlet and rectangular outlet- static regain
- Optional internal perforated sheet or aluminum foil facing
- Reheat coil available upon request

MATERIALS

- Casing : 0.7 mm thickness galvanized steel
- Damper blade : Double layer 0.7 mm thickness galvanized steel with a sandwiched peripheral gasket
- Internal insulation : 25mm (1") 32 kg/m³ (2 lb) density fiber glass with matt black tissue facing
- Bearing : Engineering plastic
- Hexagon shaft : Hexagon bar mild steel
- Differential pressure sensor : Aluminum

AIR VOLUME CONTROL TYPE

Variable Air Volume (VAV) Pressure Dependent Control

- Without differential pressure sensor
- Pressure dependent
- No monitoring of air volume

Variable Air Volume (VAV) Pressure Independent Control

- With differential pressure sensor
- Pressure independent
- Air volume varies depending on design flow and signal by controller
- Air volume could be monitored

Constant Air Volume (CAV) Pressure Independent Control

- With differential pressure sensor
- Pressure independent
- Air volume is constant (design flow) provided that the minimum static pressure is achieved

TABLE 1: DIMENSION (mm)

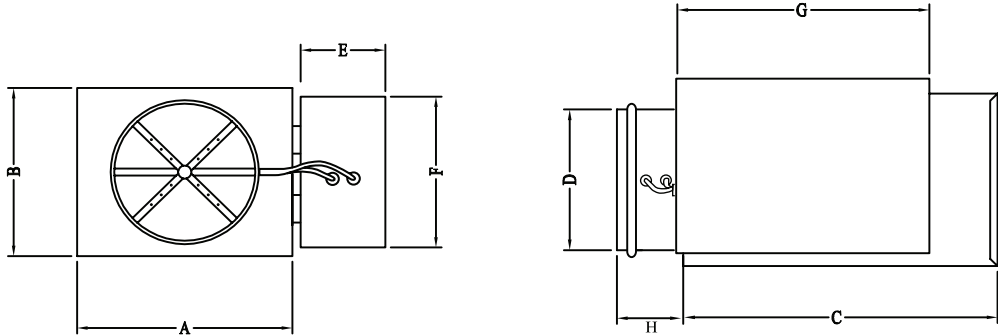


Figure 1: Basic VAV Terminal Unit

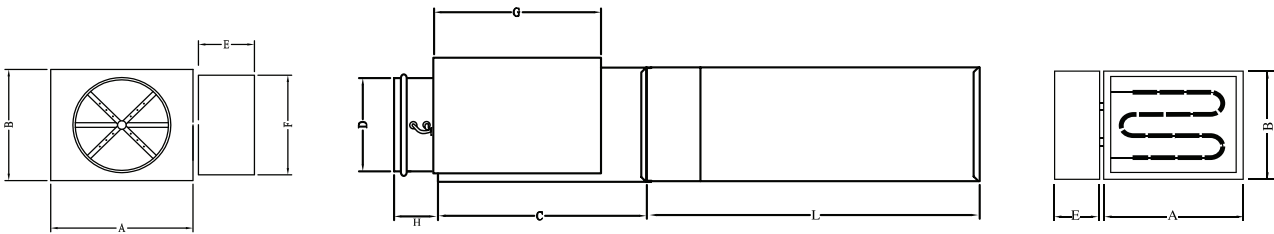


Figure 2: VAV Terminal Unit with Electric Reheat Coil

| D | A | B | C | E | F | G | L | H |
|-----------|-----|-----|-----|-----|-----|-----|-----|-----|
| 100 | 305 | 203 | 394 | 120 | 250 | 360 | 700 | 100 |
| 150 | 305 | 203 | 394 | | | | | |
| 200 | 305 | 254 | 394 | | | | | |
| 250 | 356 | 318 | 394 | | | | | |
| 300 | 406 | 381 | 394 | | | | | |
| 250 | 508 | 445 | 396 | | | | | |
| 400 | 610 | 457 | 396 | | | | | |
| 609 x 406 | 965 | 460 | 395 | | | | | |

General notes:

- Internal insulation 25mm (1”) 32 kg/m³ (2 lb) density coated to prevent air erosion.
- Galvanized steel housing.
- Mechanically seal-leak resistant construction.
- Rectangular discharge opening have drive and slip cleat duct connections as standard.
- Right hand control location standard, as shown above.
- Turbulent flow approaching the terminal will create additional noise, pressure drop and greater air flow variation. It is therefore recommended for optimum performance there should be a minimum of 4 duct diameters of straight inlet duct, same size as inlet, between the inlet and any transition, take off or fitting.

VAV UNIT

VARIABLE AIR VOLUME (VAV) PRESSURE INDEPENDENT CONTROL

TABLE 2: AIR VOLUME RANGES

| Unit Size, mm (inch) | Air Volume Range (Min - Max) | |
|----------------------|------------------------------|-------------|
| | liter/s | CFM |
| 100 (4) | 12 - 106 | 26 - 225 |
| 150 (6) | 29 - 212 | 62 - 450 |
| 200 (8) | 52 - 378 | 110 - 800 |
| 250 (10) | 85 - 637 | 180 - 1350 |
| 300 (12) | 127 - 991 | 270 - 2100 |
| 350 (14) | 189 - 1510 | 400 - 3200 |
| 400 (16) | 269 - 1888 | 570 - 4000 |
| 609 X 406 (24X16) | 1800 - 3775 | 2500 - 8000 |


TABLE 3: NSVA VAV SMART DAMPER ACTUATOR MODEL SELECTION TABLE

| MODEL / TYPE | TORQUE | POWER SUPPLY | PRESSURE DIFF. | INPUT / OUTPUT | | |
|--------------|--------|-----------------|----------------|----------------|----------------|-----------|
| | | | | Ai0, 1 | Do0, 1 | Ao0, 1 |
| NSVA 0000BL | 5 Nm | AC 100-277 ±10% | 0...500 Pa | 0 | 0 | 0 |
| NSVA 0000B | 5 Nm | AC 24 V ±10% | 0...500 Pa | 0 | 0 | 0 |
| NSVA 0200BL | 5 Nm | AC 100-277 ±10% | 0...500 Pa | Ai0 10 KΩ | Ai1 0-10VDC | 0 |
| NSVA 0200B | 5 Nm | AC 24 V ±10% | 0...500 Pa | | | 0 |
| NSVA 0222B | 5 Nm | AC 24 V ±10% | 0...500 Pa | | | 2 (24VAC) |

STANDARD MOA CONFIGURATION

Nenutec offers factory supplied and mounted electric coils for VAV terminal units. The electric reheat extension comes in separate unit which can be installed on the existing basic VAV terminal units. The electric heater coils are removable from the side of the terminal units consoled within a shroud.


VAV CONTROLLER CONTROL MODE (COOLING WITH MODULATING REHEAT)

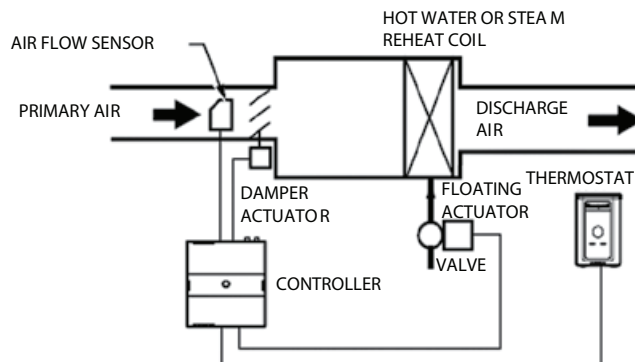

During this mode, reheat coils or hot water coil are controlled with modulating output from controller. When the room temperature is above the cooling set point, the flow shall be maximum and when the room temperature fall below cooling set point (by more than 1 degree Celsius), the flow will be minimum.


When the room temperature fall beyond heating set point, the air flow should automatically be increased to reheat flow (which is resettable). At the same time, the peripheral output will gradually increase the valve position to increase the hot water volume. Hence the supply air temperature rises.

VAV CONTROLLER CONTROL MODE (COOLING WITH PARALLEL FAN AND REHEAT)

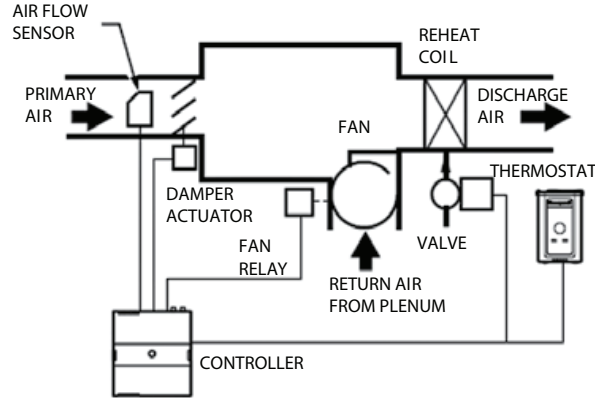

A parallel fan is not located in the primary air stream, but is designed to add return air from the plenum into the air stream delivered to the space. The controller turns on the parallel fan when the space temperature falls below set point as a first stage of reheat, or if the air flow falls below a minimum air flow set point to maintain a minimum air flow to the space (parallel flow). The heater will cut in when the room temperature drops below the heating set point.

VAV CONTROLLER CONTROL MODE (COOLING WITH SERIES FAN AND REHEAT)

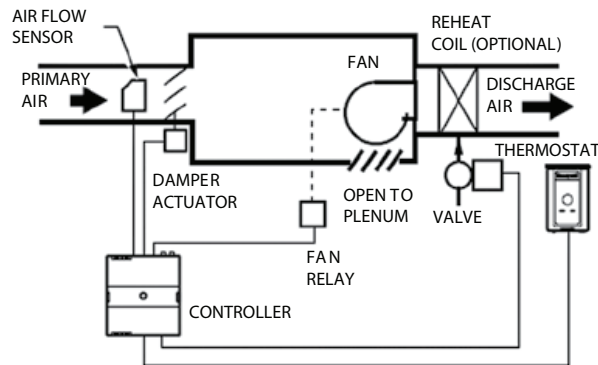

At this mode, the fan is intended to run continuously when the main air handler is on and is in-line with the primary air flow through the box. The controller will activate the fan when the primary flow is above minimum flow setting or a pre-determined flow volume, say 50 CFM whichever is higher). The heater will cut in when the room temperature drops below the heating set point.

VAV UNIT

VARIABLE AIR VOLUME (VAV) PRESSURE INDEPENDENT CONTROL

| PERFORMANCE DATA (RADIATED SOUND POWER LEVELS, BASIC ASSEMBLY UNIT) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|---|----------|------|--|----|-------------|----|----|----|----|------------------------|----|-------------|----|----|----|----|------------------------|----|-------------|----|----|----|----|------------------------|----|-------------|---|---|--|--|--|--|
| Unit Size | Air Flow | | Sound Power Level, Lw dB, re 10 ⁻¹² watts | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | ΔPs 125 Pa (0.5" W.G.) | | | | | | | ΔPs 250 Pa (1.0" W.G.) | | | | | | | ΔPs 500 Pa (2.0" W.G.) | | | | | | | ΔPs 750 Pa (3.0" W.G.) | | | | | | | | |
| | CFM | | L/s | | Octave Band | | | | | | | Octave Band | | | | | | | Octave Band | | | | | | | Octave Band | | | | | | |
| | | | | | 2 | 3 | 4 | 5 | 6 | 7 | 2 | 3 | 4 | 5 | 6 | 7 | 2 | 3 | 4 | 5 | 6 | 7 | 2 | 3 | 4 | 5 | 6 | 7 | | | | |
| 4 | 79 | 37 | 44 | 42 | 33 | 29 | 21 | 12 | 45 | 44 | 37 | 33 | 26 | 17 | 47 | 45 | 40 | 36 | 30 | 23 | 48 | 47 | 44 | 40 | 35 | 28 | | | | | | |
| | 128 | 60 | 47 | 45 | 36 | 32 | 24 | 15 | 48 | 47 | 40 | 36 | 29 | 20 | 50 | 48 | 43 | 39 | 33 | 26 | 51 | 50 | 47 | 43 | 38 | 31 | | | | | | |
| | 176 | 83 | 51 | 46 | 42 | 39 | 31 | 25 | 53 | 49 | 45 | 41 | 34 | 28 | 54 | 52 | 48 | 43 | 38 | 31 | 56 | 55 | 51 | 45 | 41 | 34 | | | | | | |
| | 225 | 106 | 54 | 50 | 46 | 44 | 37 | 30 | 56 | 53 | 48 | 45 | 39 | 32 | 57 | 55 | 50 | 46 | 41 | 34 | 59 | 58 | 52 | 47 | 43 | 36 | | | | | | |
| 6 | 158 | 74 | 45 | 43 | 34 | 30 | 22 | 13 | 47 | 45 | 38 | 34 | 27 | 19 | 49 | 48 | 43 | 39 | 33 | 25 | 51 | 50 | 47 | 43 | 38 | 31 | | | | | | |
| | 255 | 120 | 48 | 46 | 37 | 33 | 25 | 16 | 50 | 48 | 41 | 37 | 30 | 22 | 52 | 51 | 46 | 42 | 36 | 28 | 54 | 53 | 50 | 46 | 41 | 34 | | | | | | |
| | 353 | 166 | 52 | 47 | 43 | 40 | 32 | 26 | 54 | 51 | 47 | 43 | 36 | 30 | 57 | 54 | 50 | 45 | 40 | 33 | 59 | 58 | 54 | 48 | 44 | 37 | | | | | | |
| | 450 | 213 | 55 | 51 | 47 | 45 | 38 | 31 | 57 | 54 | 50 | 47 | 41 | 34 | 60 | 58 | 52 | 48 | 43 | 36 | 62 | 61 | 55 | 50 | 46 | 39 | | | | | | |
| 8 | 280 | 132 | 48 | 46 | 37 | 33 | 25 | 16 | 50 | 48 | 41 | 37 | 30 | 22 | 52 | 51 | 46 | 42 | 36 | 28 | 54 | 53 | 50 | 46 | 41 | 34 | | | | | | |
| | 453 | 214 | 51 | 49 | 40 | 36 | 28 | 19 | 53 | 51 | 44 | 40 | 33 | 25 | 55 | 54 | 49 | 45 | 39 | 31 | 57 | 56 | 53 | 49 | 44 | 37 | | | | | | |
| | 627 | 296 | 55 | 50 | 46 | 43 | 35 | 29 | 57 | 54 | 50 | 46 | 39 | 33 | 60 | 57 | 53 | 48 | 43 | 36 | 62 | 61 | 57 | 51 | 47 | 40 | | | | | | |
| | 800 | 378 | 58 | 54 | 50 | 48 | 41 | 34 | 60 | 57 | 53 | 50 | 44 | 37 | 63 | 61 | 55 | 51 | 46 | 39 | 65 | 64 | 58 | 53 | 49 | 42 | | | | | | |
| 10 | 473 | 223 | 54 | 52 | 43 | 39 | 31 | 22 | 56 | 54 | 47 | 43 | 36 | 28 | 58 | 57 | 52 | 48 | 42 | 34 | 60 | 59 | 56 | 52 | 47 | 40 | | | | | | |
| | 765 | 361 | 58 | 53 | 49 | 46 | 38 | 32 | 60 | 57 | 53 | 49 | 42 | 36 | 63 | 60 | 56 | 51 | 46 | 39 | 65 | 64 | 60 | 54 | 50 | 43 | | | | | | |
| | 1058 | 499 | 61 | 57 | 53 | 51 | 44 | 37 | 63 | 60 | 56 | 53 | 47 | 40 | 66 | 64 | 58 | 54 | 49 | 42 | 68 | 67 | 61 | 56 | 52 | 45 | | | | | | |
| | 1350 | 638 | 62 | 58 | 57 | 54 | 48 | 43 | 65 | 61 | 59 | 55 | 50 | 44 | 67 | 65 | 60 | 57 | 52 | 46 | 70 | 68 | 62 | 58 | 54 | 47 | | | | | | |
| 12 | 735 | 347 | 52 | 51 | 42 | 38 | 29 | 20 | 54 | 53 | 46 | 42 | 34 | 26 | 56 | 56 | 51 | 47 | 40 | 32 | 58 | 58 | 55 | 51 | 45 | 38 | | | | | | |
| | 1076 | 508 | 55 | 54 | 45 | 41 | 32 | 23 | 57 | 56 | 49 | 45 | 37 | 29 | 59 | 59 | 54 | 50 | 43 | 35 | 61 | 61 | 58 | 54 | 48 | 41 | | | | | | |
| | 1418 | 669 | 59 | 55 | 51 | 48 | 39 | 33 | 61 | 59 | 55 | 51 | 43 | 37 | 64 | 62 | 58 | 53 | 47 | 40 | 66 | 66 | 62 | 56 | 51 | 44 | | | | | | |
| | 1759 | 831 | 62 | 59 | 55 | 53 | 45 | 38 | 64 | 62 | 58 | 55 | 48 | 41 | 67 | 66 | 60 | 56 | 50 | 43 | 69 | 69 | 63 | 58 | 53 | 46 | | | | | | |
| | 2100 | 992 | 63 | 60 | 59 | 56 | 49 | 44 | 66 | 63 | 61 | 57 | 51 | 45 | 68 | 67 | 62 | 59 | 53 | 47 | 71 | 70 | 64 | 60 | 55 | 48 | | | | | | |
| 14 | 1120 | 529 | 53 | 52 | 43 | 39 | 30 | 21 | 55 | 54 | 47 | 43 | 35 | 27 | 57 | 57 | 52 | 48 | 41 | 33 | 59 | 59 | 56 | 52 | 46 | 39 | | | | | | |
| | 1640 | 774 | 57 | 56 | 47 | 43 | 34 | 25 | 59 | 58 | 51 | 47 | 39 | 31 | 61 | 61 | 56 | 52 | 45 | 37 | 63 | 63 | 60 | 56 | 50 | 43 | | | | | | |
| | 2160 | 1020 | 61 | 59 | 52 | 49 | 41 | 33 | 63 | 61 | 56 | 52 | 45 | 37 | 65 | 64 | 59 | 55 | 49 | 41 | 67 | 67 | 63 | 58 | 53 | 46 | | | | | | |
| | 2680 | 1266 | 64 | 61 | 57 | 55 | 47 | 40 | 66 | 64 | 60 | 57 | 50 | 43 | 69 | 68 | 62 | 58 | 52 | 45 | 71 | 71 | 65 | 60 | 55 | 48 | | | | | | |
| | 3200 | 1511 | 65 | 62 | 61 | 58 | 51 | 46 | 68 | 65 | 63 | 59 | 53 | 47 | 70 | 69 | 64 | 61 | 55 | 49 | 73 | 72 | 66 | 62 | 57 | 50 | | | | | | |
| 16 | 1400 | 661 | 51 | 50 | 41 | 39 | 30 | 21 | 53 | 52 | 45 | 43 | 35 | 27 | 55 | 55 | 50 | 48 | 41 | 33 | 57 | 57 | 54 | 52 | 46 | 39 | | | | | | |
| | 1920 | 907 | 54 | 53 | 44 | 42 | 33 | 24 | 56 | 55 | 48 | 46 | 38 | 30 | 58 | 58 | 53 | 51 | 44 | 36 | 60 | 60 | 57 | 55 | 49 | 42 | | | | | | |
| | 2440 | 1152 | 58 | 57 | 48 | 46 | 37 | 28 | 60 | 59 | 52 | 50 | 42 | 34 | 62 | 62 | 57 | 55 | 48 | 40 | 64 | 64 | 61 | 59 | 53 | 46 | | | | | | |
| | 2960 | 1398 | 62 | 60 | 53 | 52 | 44 | 36 | 64 | 62 | 57 | 55 | 48 | 40 | 66 | 65 | 60 | 58 | 52 | 44 | 68 | 68 | 64 | 61 | 56 | 49 | | | | | | |
| | 3480 | 1643 | 65 | 62 | 58 | 58 | 50 | 43 | 67 | 65 | 61 | 60 | 53 | 46 | 70 | 69 | 63 | 61 | 55 | 48 | 72 | 72 | 66 | 63 | 58 | 51 | | | | | | |
| | 4000 | 1889 | 66 | 63 | 62 | 61 | 54 | 49 | 69 | 66 | 64 | 62 | 56 | 50 | 71 | 70 | 65 | 64 | 58 | 52 | 74 | 73 | 67 | 65 | 60 | 53 | | | | | | |
| 24 x 16 | 2800 | 1322 | 70 | 67 | 63 | 61 | 53 | 46 | 72 | 70 | 66 | 63 | 56 | 49 | 75 | 74 | 68 | 64 | 58 | 51 | 77 | 77 | 71 | 66 | 61 | 54 | | | | | | |
| | 3840 | 1813 | 71 | 68 | 67 | 64 | 57 | 52 | 74 | 71 | 69 | 65 | 59 | 53 | 76 | 75 | 70 | 67 | 61 | 55 | 79 | 78 | 72 | 68 | 63 | 56 | | | | | | |
| | 4880 | 2304 | 57 | 56 | 47 | 45 | 36 | 27 | 59 | 58 | 51 | 49 | 41 | 33 | 61 | 61 | 56 | 54 | 47 | 39 | 63 | 63 | 60 | 58 | 52 | 45 | | | | | | |
| | 5920 | 2796 | 60 | 59 | 50 | 48 | 39 | 30 | 62 | 61 | 54 | 52 | 44 | 36 | 64 | 64 | 59 | 57 | 50 | 42 | 66 | 66 | 63 | 61 | 55 | 48 | | | | | | |
| | 6960 | 3287 | 64 | 63 | 54 | 52 | 43 | 34 | 66 | 65 | 58 | 56 | 48 | 40 | 68 | 68 | 63 | 61 | 54 | 46 | 70 | 70 | 67 | 65 | 59 | 52 | | | | | | |
| | 8000 | 3778 | 68 | 66 | 59 | 58 | 50 | 42 | 70 | 68 | 63 | 61 | 54 | 46 | 72 | 71 | 66 | 64 | 58 | 50 | 74 | 74 | 70 | 67 | 62 | 55 | | | | | | |

PERFORMANCE DATA (DISCHARGE SOUND POWER LEVELS, BASIC ASSEMBLY UNIT)

| Unit Size | Air Flow | | Sound Power Level, Lw dB, re 10 ⁻¹² watts | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----------|----------|------|--|----|-------------|----|----|----|----|------------------------|----|-------------|----|----|----|----|------------------------|----|-------------|----|----|----|----|------------------------|----|-------------|---|---|--|--|--|--|
| | | | ΔPs 125 Pa (0.5" W.G.) | | | | | | | ΔPs 250 Pa (1.0" W.G.) | | | | | | | ΔPs 500 Pa (2.0" W.G.) | | | | | | | ΔPs 750 Pa (3.0" W.G.) | | | | | | | | |
| | CFM | | L/s | | Octave Band | | | | | | | Octave Band | | | | | | | Octave Band | | | | | | | Octave Band | | | | | | |
| | | | | | 2 | 3 | 4 | 5 | 6 | 7 | 2 | 3 | 4 | 5 | 6 | 7 | 2 | 3 | 4 | 5 | 6 | 7 | 2 | 3 | 4 | 5 | 6 | 7 | | | | |
| 4 | 79 | 37 | 43 | 42 | 40 | 36 | 34 | 30 | 46 | 47 | 45 | 43 | 41 | 37 | 50 | 51 | 49 | 49 | 47 | 43 | 53 | 56 | 54 | 56 | 54 | 50 | | | | | | |
| | 128 | 60 | 47 | 46 | 44 | 40 | 38 | 34 | 50 | 51 | 49 | 47 | 45 | 41 | 54 | 55 | 53 | 53 | 51 | 47 | 57 | 60 | 58 | 60 | 58 | 54 | | | | | | |
| | 176 | 83 | 51 | 51 | 52 | 50 | 45 | 41 | 55 | 56 | 57 | 55 | 51 | 47 | 59 | 60 | 61 | 61 | 58 | 54 | 63 | 65 | 66 | 66 | 64 | 60 | | | | | | |
| | 225 | 106 | 55 | 56 | 58 | 55 | 49 | 48 | 59 | 59 | 62 | 60 | 55 | 52 | 63 | 62 | 65 | 64 | 61 | 57 | 67 | 65 | 69 | 69 | 67 | 61 | | | | | | |
| 6 | 158 | 74 | 47 | 46 | 41 | 37 | 36 | 31 | 50 | 51 | 46 | 44 | 42 | 38 | 54 | 55 | 50 | 50 | 49 | 46 | 57 | 60 | 55 | 57 | 55 | 53 | | | | | | |
| | 255 | 120 | 51 | 50 | 45 | 41 | 40 | 35 | 54 | 55 | 50 | 48 | 46 | 42 | 58 | 59 | 54 | 54 | 53 | 50 | 61 | 64 | 59 | 61 | 59 | 57 | | | | | | |
| | 353 | 166 | 55 | 55 | 53 | 51 | 47 | 42 | 59 | 60 | 58 | 56 | 53 | 49 | 63 | 64 | 62 | 62 | 59 | 56 | 67 | 69 | 67 | 67 | 65 | 63 | | | | | | |
| | 450 | 213 | 59 | 60 | 59 | 56 | 51 | 49 | 63 | 63 | 63 | 61 | 57 | 54 | 67 | 66 | 66 | 65 | 62 | 59 | 71 | 69 | 70 | 70 | 68 | 64 | | | | | | |
| 8 | 280 | 132 | 52 | 51 | 46 | 42 | 41 | 36 | 55 | 56 | 51 | 49 | 47 | 43 | 59 | 60 | 55 | 55 | 54 | 51 | 62 | 65 | 60 | 62 | 60 | 58 | | | | | | |
| | 453 | 214 | 55 | 54 | 49 | 45 | 44 | 39 | 58 | 59 | 54 | 52 | 50 | 46 | 62 | 63 | 58 | 58 | 57 | 54 | 65 | 68 | 63 | 65 | 63 | 61 | | | | | | |
| | 627 | 296 | 58 | 58 | 54 | 52 | 48 | 43 | 62 | 63 | 59 | 57 | 54 | 51 | 66 | 67 | 63 | 63 | 60 | 58 | 70 | 72 | 68 | 68 | 66 | 66 | | | | | | |
| | 800 | 378 | 62 | 63 | 60 | 57 | 52 | 50 | 66 | 66 | 64 | 62 | 58 | 56 | 70 | 69 | 67 | 66 | 63 | 61 | 74 | 72 | 71 | 71 | 69 | 67 | | | | | | |
| 10 | 473 | 223 | 58 | 57 | 52 | 48 | 47 | 42 | 61 | 62 | 57 | 55 | 53 | 49 | 65 | 66 | 61 | 61 | 60 | 57 | 68 | 71 | 66 | 68 | 66 | 64 | | | | | | |
| | 765 | 361 | 59 | 59 | 54 | 52 | 49 | 45 | 63 | 64 | 59 | 58 | 55 | 52 | 66 | 68 | 63 | 63 | 61 | 59 | 70 | 73 | 68 | 69 | 67 | 66 | | | | | | |
| | 1058 | 499 | 61 | 61 | 55 | 53 | 50 | 46 | 65 | 66 | 60 | 58 | 56 | 53 | 69 | 70 | 64 | 64 | 61 | 60 | 73 | 75 | 69 | 69 | 67 | 67 | | | | | | |
| | 1350 | 638 | 65 | 66 | 61 | 58 | 54 | 53 | 69 | 69 | 65 | 63 | 59 | 58 | 73 | 72 | 68 | 67 | 65 | 63 | 77 | 75 | 72 | 72 | 70 | 68 | | | | | | |
| 12 | 735 | 347 | 58 | 56 | 52 | 48 | 47 | 41 | 62 | 61 | 57 | 55 | 54 | 49 | 64 | 64 | 60 | 60 | 58 | 54 | 69 | 70 | 67 | 69 | 67 | 64 | | | | | | |
| | 1076 | 508 | 60 | 58 | 54 | 50 | 49 | 43 | 64 | 63 | 59 | 57 | 56 | 51 | 66 | 66 | 62 | 62 | 60 | 56 | 71 | 72 | 69 | 71 | 69 | 66 | | | | | | |
| | 1418 | 669 | 61 | 60 | 56 | 54 | 51 | 46 | 65 | 65 | 61 | 60 | 57 | 53 | 68 | 68 | 64 | 64 | 62 | 58 | 73 | 74 | 71 | 72 | 70 | 68 | | | | | | |
| | 1759 | 831 | 63 | 62 | 57 | 55 | 52 | 47 | 67 | 67 | 62 | 61 | 58 | 54 | 70 | 70 | 65 | 64 | 62 | 59 | 76 | 76 | 72 | 72 | 70 | 69 | | | | | | |
| | 2100 | 992 | 67 | 67 | 63 | 60 | 56 | 54 | 71 | 70 | 67 | 65 | 62 | 59 | 74 | 72 | 70 | 68 | 65 | 63 | 80 | 76 | 75 | 75 | 73 | 70 | | | | | | |
| 14 | 1120 | 529 | 60 | 57 | 54 | 50 | 49 | 43 | 64 | 62 | 59 | 57 | 56 | 50 | 67 | 66 | 64 | 64 | 62 | 58 | 71 | 71 | 69 | 71 | 69 | 65 | | | | | | |
| | 1640 | 774 | 62 | 59 | 56 | 52 | 51 | 44 | 66 | 64 | 61 | 59 | 58 | 52 | 69 | 68 | 66 | 66 | 64 | 59 | 73 | 73 | 71 | 73 | 71 | 67 | | | | | | |
| | 2160 | 1020 | 63 | 61 | 58 | 56 | 53 | 47 | 67 | 66 | 63 | 62 | 59 | 54 | 71 | 70 | 68 | 68 | 66 | 62 | 75 | 75 | 73 | 74 | 72 | 69 | | | | | | |
| | 2680 | 1266 | 65 | 63 | 59 | 57 | 54 | 48 | 69 | 68 | 64 | 63 | 60 | 55 | 74 | 72 | 69 | 68 | 66 | 63 | 78 | 77 | 74 | 74 | 72 | 70 | | | | | | |
| | 3200 | 1511 | 69 | 68 | 65 | 62 | 58 | 55 | 73 | 71 | 69 | 67 | 64 | 60 | 78 | 74 | 73 | 72 | 69 | 66 | 82 | 77 | 77 | 77 | 75 | 71 | | | | | | |
| 16 | 1400 | 661 | 62 | 59 | 56 | 52 | 51 | 44 | 65 | 63 | 60 | 58 | 57 | 52 | 67 | 66 | 64 | 64 | 63 | 60 | 70 | 70 | 68 | 70 | 69 | 68 | | | | | | |
| | 1920 | 907 | 64 | 60 | 58 | 54 | 53 | 45 | 67 | 64 | 62 | 60 | 59 | 54 | 70 | 69 | 67 | 67 | 66 | 62 | 73 | 73 | 71 | 73 | 72 | 71 | | | | | | |
| | 2440 | 1152 | 65 | 62 | 60 | 58 | 55 | 48 | 68 | 66 | 64 | 64 | 62 | 56 | 72 | 71 | 69 | 69 | 68 | 64 | 75 | 75 | 73 | 75 | 75 | 72 | | | | | | |
| | 2960 | 1398 | 66 | 63 | 61 | 59 | 56 | 49 | 70 | 68 | 65 | 64 | 61 | 55 | 73 | 72 | 70 | 70 | 66 | 61 | 77 | 77 | 75 | 76 | 71 | 67 | | | | | | |
| | 3480 | 1643 | 67 | 64 | 61 | 59 | 56 | 49 | 71 | 69 | 66 | 65 | 62 | 56 | 76 | 74 | 71 | 70 | 67 | 62 | 80 | 79 | 76 | 76 | 73 | 69 | | | | | | |
| | 4000 | 1889 | 71 | 69 | 67 | 64 | 60 | 56 | 75 | 72 | 71 | 69 | 65 | 61 | 80 | 76 | 75 | 74 | 69 | 66 | 84 | 79 | 79 | 79 | 74 | 71 | | | | | | |
| 24 x 16 | 2800 | 1322 | 68 | 65 | 62 | 58 | 57 | 50 | 69 | 67 | 66 | 64 | 63 | 58 | 70 | 70 | 70 | 70 | 69 | 66 | 71 | 72 | 74 | 76 | 75 | 74 | | | | | | |
| | 3840 | 1813 | 70 | 66 | 64 | 60 | 59 | 51 | 71 | 69 | 68 | 66 | 65 | 60 | 73 | 72 | 73 | 73 | 72 | 68 | 74 | 75 | 77 | 79 | 78 | 77 | | | | | | |
| | 4880 | 2304 | 71 | 68 | 66 | 64 | 61 | 54 | 73 | 71 | 70 | 70 | 68 | 62 | 74 | 74 | 75 | 75 | 74 | 70 | 76 | 77 | 79 | 81 | 81 | 78 | | | | | | |
| | 5920 | 2796 | 72 | 69 | 67 | 65 | 62 | 55 | 74 | 72 | 71 | 70 | 67 | 61 | 76 | 76 | 76 | 76 | 72 | 67 | 78 | 79 | 81 | 82 | 77 | 73 | | | | | | |
| | 6960 | 3287 | 73 | 70 | 67 | 65 | 62 | 55 | 76 | 74 | 72 | 71 | 68 | 62 | 78 | 77 | 77 | 76 | 73 | 68 | 81 | 81 | 82 | 82 | 79 | 75 | | | | | | |
| | 8000 | 3778 | 77 | 75 | 73 | 70 | 66 | 62 | 80 | 77 | 77 | 75 | 71 | 67 | 82 | 79 | 81 | 80 | 75 | 72 | 85 | 81 | 85 | 85 | 80 | 77 | | | | | | |

VAV UNIT

VARIABLE AIR VOLUME (VAV) PRESSURE INDEPENDENT CONTROL

| PERFORMANCE DATA (TYPICAL SELECTION GUIDE) | | | | | | | | | | | | | | | | | | | | | | | |
|--|----------|------|---|------|---|------|-----------------------------|--------|--------------------------|--------|--------|--------|--------|--------------------------|--------|--------|--------|--------------------------|--------|------|------|------|------|
| Unit Size | Air Flow | | Minimum ΔP_s Across Unit Basic Unit | | Minimum P_s Across Unit With Attenuator | | Min ΔP_t Basic Unit | | Discharge NC | | | | | Discharge NC | | | | Radiated NC | | | | | |
| | | | | | | | | | Basic Unit | | | | | c/w 36" Attenuator | | | | Basic Unit | | | | | |
| | | | | | | | | | ΔP_s Across Unit | | | | | ΔP_s Across Unit | | | | ΔP_s Across Unit | | | | | |
| | | | | | | | | | Min | 0.5" | 1.0" | 2.0" | 3.0" | Min | 0.5" | 1.0" | 2.0" | 3.0" | Min | 0.5" | 1.0" | 2.0" | 3.0" |
| | | | | | | | | | | W.G. | W.G. | W.G. | W.G. | | W.G. | W.G. | W.G. | W.G. | | W.G. | W.G. | W.G. | W.G. |
| CFM | L/s | W.G. | Pa | W.G. | Pa | W.G. | Pa | 125 Pa | 250 Pa | 500 Pa | 750 Pa | 125 Pa | 250 Pa | 500 Pa | 750 Pa | 125 Pa | 250 Pa | 500 Pa | 750 Pa | | | | |
| 4 | 79 | 37 | 0.01 | 2 | 0.01 | 2 | 0.06 | 14 | - | - | - | - | 22 | - | - | - | - | 20 | - | - | - | - | |
| | 128 | 60 | 0.01 | 2 | 0.01 | 2 | 0.14 | 35 | - | - | - | - | 26 | - | - | - | - | 24 | - | - | - | 20 | |
| | 176 | 83 | 0.02 | 5 | 0.02 | 5 | 0.27 | 67 | - | - | - | 26 | 31 | - | - | - | 24 | 29 | - | - | - | 21 | 24 |
| | 225 | 106 | 0.04 | 10 | 0.04 | 10 | 0.45 | 112 | - | 20 | 24 | 29 | 32 | - | - | 22 | 27 | 30 | - | - | 22 | 24 | 28 |
| 6 | 158 | 74 | 0.01 | 2 | 0.01 | 2 | 0.04 | 11 | - | - | - | - | 25 | - | - | - | - | 20 | - | - | - | - | 20 |
| | 255 | 120 | 0.03 | 7 | 0.03 | 7 | 0.12 | 31 | - | - | - | 22 | 29 | - | - | - | - | 24 | - | - | - | - | 23 |
| | 353 | 166 | 0.10 | 25 | 0.10 | 25 | 0.28 | 71 | - | - | 21 | 28 | 34 | - | - | - | 23 | 29 | - | - | 20 | 23 | 28 |
| | 450 | 213 | 0.21 | 53 | 0.21 | 53 | 0.51 | 128 | - | 21 | 26 | 30 | 35 | - | - | 21 | 25 | 30 | - | 20 | 23 | 28 | 32 |
| 8 | 280 | 132 | 0.01 | 2 | 0.01 | 2 | 0.04 | 10 | - | - | - | 23 | 30 | - | - | - | - | 22 | - | - | - | - | 23 |
| | 453 | 214 | 0.01 | 2 | 0.01 | 2 | 0.04 | 24 | - | - | - | 26 | 32 | - | - | - | - | 24 | - | - | - | 23 | 27 |
| | 627 | 296 | 0.02 | 6 | 0.02 | 6 | 0.19 | 47 | - | - | 23 | 30 | 37 | - | - | - | 22 | 29 | - | - | 23 | 27 | 32 |
| | 800 | 378 | 0.06 | 16 | 0.06 | 16 | 0.33 | 83 | - | 23 | 28 | 32 | 38 | - | - | 20 | 24 | 30 | - | 23 | 27 | 32 | 35 |
| 10 | 473 | 223 | 0.01 | 2 | 0.01 | 2 | 0.05 | 11 | - | - | 20 | 27 | 33 | - | - | - | 22 | 28 | - | 20 | 23 | 27 | 30 |
| | 765 | 361 | 0.01 | 2 | 0.01 | 2 | 0.11 | 26 | - | - | 23 | 29 | 35 | - | - | - | 24 | 30 | - | 22 | 27 | 30 | 35 |
| | 1058 | 499 | 0.02 | 6 | 0.02 | 6 | 0.21 | 53 | - | - | 25 | 30 | 36 | - | - | 20 | 25 | 31 | 22 | 27 | 30 | 35 | 38 |
| | 1350 | 638 | 0.06 | 16 | 0.06 | 16 | 0.37 | 92 | - | 25 | 29 | 33 | 37 | - | 20 | 24 | 28 | 32 | 26 | 31 | 33 | 36 | 39 |
| 12 | 735 | 347 | 0.01 | 2 | 0.01 | 2 | 0.05 | 13 | - | - | - | 24 | 33 | - | - | - | - | 27 | - | - | 22 | 25 | 29 |
| | 1076 | 508 | 0.01 | 2 | 0.01 | 2 | 0.10 | 25 | - | - | 22 | 26 | 35 | - | - | - | 20 | 29 | - | 23 | 25 | 29 | 32 |
| | 1418 | 669 | 0.01 | 2 | 0.01 | 2 | 0.17 | 41 | - | - | 24 | 28 | 37 | - | - | - | 22 | 31 | - | 24 | 29 | 33 | 37 |
| | 1759 | 831 | 0.02 | 4 | 0.02 | 4 | 0.26 | 65 | - | 20 | 27 | 30 | 38 | - | - | 23 | 26 | 34 | 24 | 29 | 33 | 37 | 40 |
| | 2100 | 992 | 0.04 | 10 | 0.04 | 10 | 0.39 | 96 | 21 | 27 | 30 | 33 | 39 | - | 23 | 26 | 29 | 35 | 28 | 33 | 35 | 38 | 42 |
| 14 | 1120 | 529 | 0.01 | 2 | 0.01 | 2 | 0.06 | 16 | - | - | - | 26 | 32 | - | - | - | 22 | 28 | - | 20 | 23 | 27 | 30 |
| | 1640 | 774 | 0.01 | 2 | 0.01 | 2 | 0.13 | 32 | - | - | 22 | 27 | 34 | - | - | - | 23 | 30 | - | 25 | 28 | 32 | 34 |
| | 2160 | 1020 | 0.01 | 2 | 0.01 | 2 | 0.21 | 53 | - | - | 24 | 30 | 36 | - | - | 20 | 26 | 32 | 24 | 29 | 32 | 35 | 38 |
| | 2680 | 1266 | 0.02 | 6 | 0.02 | 6 | 0.34 | 85 | - | 20 | 27 | 32 | 37 | - | - | 23 | 28 | 33 | 27 | 32 | 35 | 39 | 43 |
| | 3200 | 1511 | 0.06 | 16 | 0.06 | 16 | 0.52 | 128 | 21 | 27 | 30 | 34 | 38 | - | 23 | 26 | 30 | 34 | 30 | 35 | 37 | 40 | 44 |
| 16 | 1400 | 661 | 0.01 | 2 | 0.01 | 2 | 0.06 | 14 | - | - | 20 | 25 | 31 | - | - | - | 19 | 25 | - | - | 20 | 24 | 28 |
| | 1920 | 907 | 0.01 | 2 | 0.01 | 2 | 0.10 | 25 | - | - | 22 | 28 | 34 | - | - | - | 22 | 28 | - | 22 | 24 | 28 | 31 |
| | 2440 | 1152 | 0.01 | 2 | 0.01 | 2 | 0.16 | 39 | - | - | 24 | 30 | 36 | - | - | - | 24 | 30 | 22 | 27 | 29 | 33 | 35 |
| | 2960 | 1398 | 0.01 | 2 | 0.01 | 2 | 0.23 | 57 | - | 20 | 27 | 32 | 38 | - | - | 23 | 28 | 34 | 25 | 30 | 33 | 36 | 39 |
| | 3480 | 1643 | 0.02 | 5 | 0.02 | 5 | 0.32 | 81 | - | 22 | 28 | 34 | 39 | - | - | 24 | 30 | 35 | 28 | 33 | 36 | 40 | 44 |
| | 4000 | 1889 | 0.05 | 12 | 0.05 | 12 | 0.45 | 112 | 23 | 28 | 32 | 36 | 40 | - | 24 | 28 | 32 | 36 | 31 | 36 | 38 | 42 | 45 |
| 24 x 16 | 2800 | 1322 | 0.01 | 2 | 0.01 | 2 | 0.06 | 14 | - | 23 | 25 | 30 | 37 | - | 21 | 23 | 28 | 35 | 20 | 25 | 28 | 32 | 34 |
| | 3840 | 1813 | 0.02 | 5 | 0.02 | 5 | 0.11 | 27 | - | 24 | 28 | 33 | 40 | - | 22 | 26 | 31 | 38 | 24 | 29 | 32 | 35 | 37 |
| | 4880 | 2304 | 0.04 | 9 | 0.04 | 9 | 0.18 | 45 | 22 | 27 | 30 | 35 | 42 | 20 | 25 | 28 | 33 | 40 | 29 | 34 | 36 | 39 | 42 |
| | 5920 | 2796 | 0.06 | 15 | 0.06 | 15 | 0.27 | 68 | 23 | 28 | 32 | 37 | 44 | 21 | 26 | 30 | 35 | 42 | 32 | 37 | 39 | 43 | 48 |
| | 6960 | 3287 | 0.10 | 24 | 0.10 | 24 | 0.39 | 97 | 24 | 29 | 34 | 37 | 45 | 22 | 27 | 32 | 35 | 43 | 34 | 39 | 43 | 48 | 52 |
| | 8000 | 3778 | 0.16 | 40 | 0.16 | 40 | 0.55 | 136 | 30 | 35 | 37 | 40 | 46 | 28 | 33 | 35 | 38 | 44 | 38 | 43 | 45 | 49 | 53 |

- NC are derived from sound power level, which are obtained in accordance with ARI standard 885-98.
- ΔP_s is the difference in static pressure from inlet to discharge of the unit.
- ΔP_t is the difference in total pressure from inlet to discharge of the unit.
- ΔP_s for terminal units with electric coils is equal to basic unit. Resistance of the coil elements is negligible.
- Dash(-) in space indicates NC less than 20.